



**US Army Corps
of Engineers** ®
Fort Worth District

Public Notice

Section 408 Request ID #: 408-SWF-2019-0003

Date issued: July 10, 2019

Close of comment period: August 11, 2019

USACE Point of Contact: Jason Story

REQUEST TO ALTER A U.S. ARMY CORPS OF ENGINEERS FEDERALLY AUTHORIZED CIVIL WORKS PROJECT UNDER 33 USC 408 (SECTION 408)

TITLE: Section 408 Request ID # 408-SWF-2019-0003, Oncor Sargent Road.

SUBJECT: Request for a Section 408 permission to alter the Dallas Floodway Extension, a U.S. Army Corps of Engineers (USACE) federally authorized Civil Works project. Written comments are being solicited from anyone having an interest in this proposed alteration. Comments will become part of the USACE administrative record and will be considered in determining whether to approve the proposed alteration. Comments supporting, opposing, or identifying concerns that should be considered by the USACE in its decision process are all welcome. Issuance of this notice does not imply USACE endorsement of the proposed alteration as described.

REQUESTER: Oncor Electric Delivery Company (Oncor).

LOCATION: The proposed project would begin near the Central Waste Water Treatment Plant. The proposed project would continue north and east where it would cross the Trinity River and proceed along the river side of Rochester Levee.

NON-FEDERAL SPONSOR: The City of Dallas.

LOCATION MAP(S)/DRAWING(S): Figure 1.

DESCRIPTION OF THE PROPOSED ALTERATION: The proposed alteration consists of activities within the Dallas Floodway Extension. Steel monopole electric transmission towers would be constructed within an existing right of way.

REGULATORY AUTHORITY: This request will be reviewed pursuant to Section 14 of the Rivers and Harbors Act of 1899 (33 USC 408). A requestor has the responsibility to acquire other authorizations required by federal, state, and local laws or regulations, including any required permits from the USACE Regulatory Program. An approval under Section 408 does not grant any property rights or exclusive privileges nor does it authorize any injury to the property or rights of others.

EVALUATION: The decision whether to grant the request for the alteration under Section 408 is based on several factors which are outlined in Engineer Circular 1165-2-220. The benefits which reasonably may be expected to accrue from the proposed alteration must be balanced against its reasonably foreseeable detriments. Review of the proposed alteration will be reviewed by a USACE technical review team considering the following factors:

1. *Impacts to the Usefulness of the USACE Project Determination.* The review team will determine if the proposed alteration would limit the ability of the federally authorized project to function as authorized, or would compromise or change any authorized project conditions, purposes or outputs.

2. *Injurious to the Public Interest Determination.* The review team will determine the probable impacts of the proposed alteration, including cumulative impacts, on the public interest. Factors that may be relevant to the public interest may include, but are not limited to, such things as conservation, economic development, historic properties, cultural resources, environmental impacts, water supply, water quality, flood hazards, floodplains, residual risk, induced damages, navigation, shore erosion or accretion, and recreation.

3. *Environmental Compliance.* A decision on a Section 408 request is a federal action subject to the National Environmental Policy Act (NEPA) and other applicable federal environmental and cultural resources compliance requirements.

THREATENED AND ENDANGERED SPECIES: The USACE has reviewed an official list of species protected under the Endangered Species Act, and our initial review indicates the proposed alteration would have no effect to species listed by the United States Fish and Wildlife Service as threatened or endangered within the action area for the Section 408 jurisdiction.

HISTORIC, CULTURAL, AND ARCHAEOLOGICAL RESOURCES: The USACE has reviewed a cultural resources report provided by the requester. The existing records search conducted by the cultural resources contractor revealed that various cultural resources are located within one mile of the project area of potential impact including 16 previous cultural resources surveys, 14 archaeological sites, 2 Official Texas Historical Markers, and 3 cemeteries. A majority of the area of potential impact is located in flood plain or stream terrace landscape, combined with deep soils, which provides a high probability for buried cultural resources. Due to the presence of sites in the area, along with high potential archaeological site areas along the Trinity River which transects the project area, it is required that cultural resources monitoring during any drilling or other ground disturbing work be accomplished. Concurrence by the Texas Historical Commission/ State Historic Preservation Officer (THC/SHPO) for this action is required. An on-the ground cultural resources survey prior to commencement of construction may be required by THC/SHPO. Further, during construction, should buried cultural deposits



be encountered, all construction in the vicinity of the discovery would need to cease and USACE and the THC/SHPO be notified immediately.

SOLICITATION OF COMMENTS: The USACE is soliciting comments from the public; federal, state, and local agencies and officials; Indian Tribes; and other interested parties in order to consider and evaluate the impacts of the proposed alteration. Comments received will be considered by the USACE to determine whether to issue, modify, condition, or deny a permission for this proposed alteration.

It should be noted that materials submitted as part of the Section 408 request become part of the public record and are available to the public under the Freedom of Information Act (FOIA). Individuals may submit a written request to obtain materials under FOIA or make an appointment to view the project file at the Fort Worth District, Corps of Engineers, Office of Counsel.

It is presumed that all parties receiving this notice will wish to respond to this public notice; therefore, a lack of response will be interpreted as meaning that there is no objection to the proposed alteration as described herein.

CLOSE OF COMMENT PERIOD: Written comments on the proposed alteration must reach this office on or before the close of the comment period. Comments must reference the Section 408 Request ID # and project name. Comments and requests for additional information should be submitted to CESWF-PEC-CI, ATTN: Mr. Jason Story, P.O. Box 17300 Fort Worth, TX 76102-0300. Email inquiries should be directed to jason.e.story@usace.army.mil. Telephone inquiries should be directed to Mr. Jason Story, at (817) 886-1852. Please note that names and addresses of those who submit comments in response to this public notice may be made publicly available. For more information on Section 408, visit the Fort Worth District Section 408 webpage at <https://www.swf.usace.army.mil/Missions/Section-408/>.

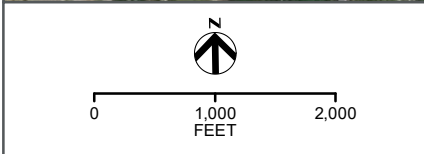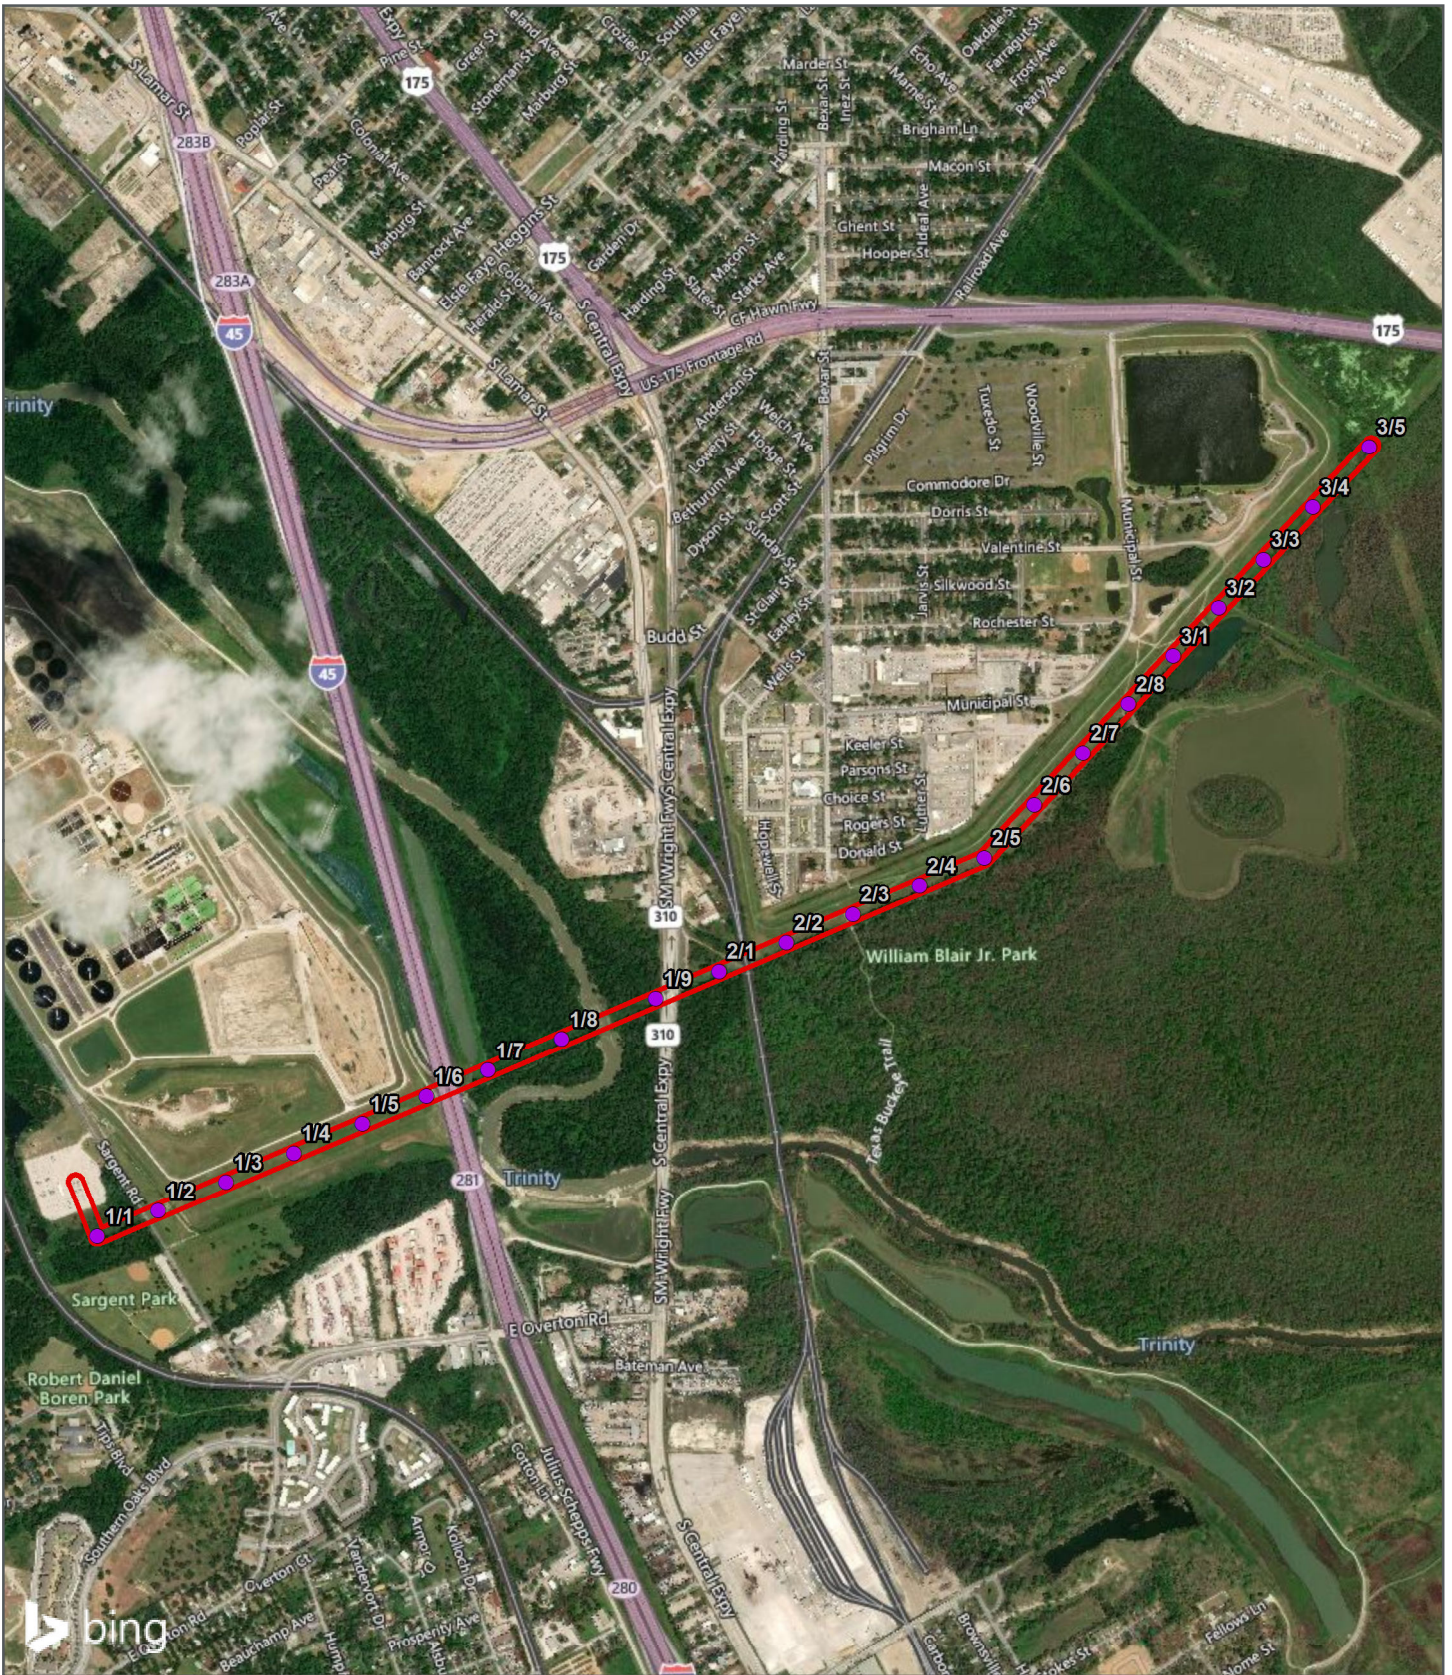

- STUDY AREA
- TRANSMISSION LINE STRUCTURE



Figure 1.
SITE MAP ON AERIAL
 SARGENT ROAD - PEMBERTON
 138 KV TRANSMISSION LINE

JUL 2019	FIGURE 1
----------	----------